


ROS-2210 Wiring diagram

Notes:
If only one outlet conductivity electrode
(single electrode mode) is connected, the red
line of outlet conductivity electrode shall be
connected to terminal 20, otherwise the
temperature display is inaccurate, affecting

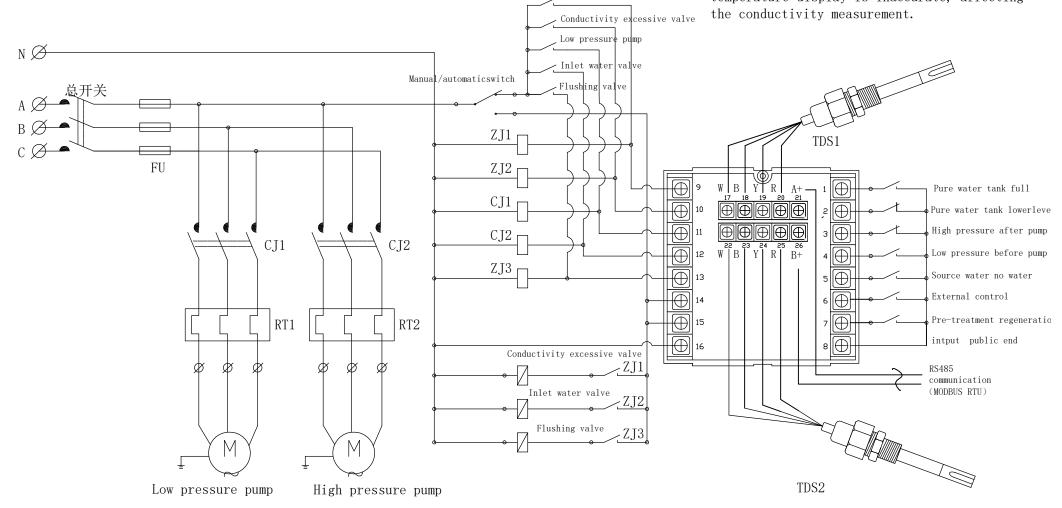

High pressure pump

power control

Low pressure High pressure pump pump

actuator

control instrument

signal detection







Shanghai ChiMay Techology LTD
www.chimaytech.com / www.shchimay.com

chimay@chimaytech.com WhatsApp/Cellphone:+86 131 1777 5471